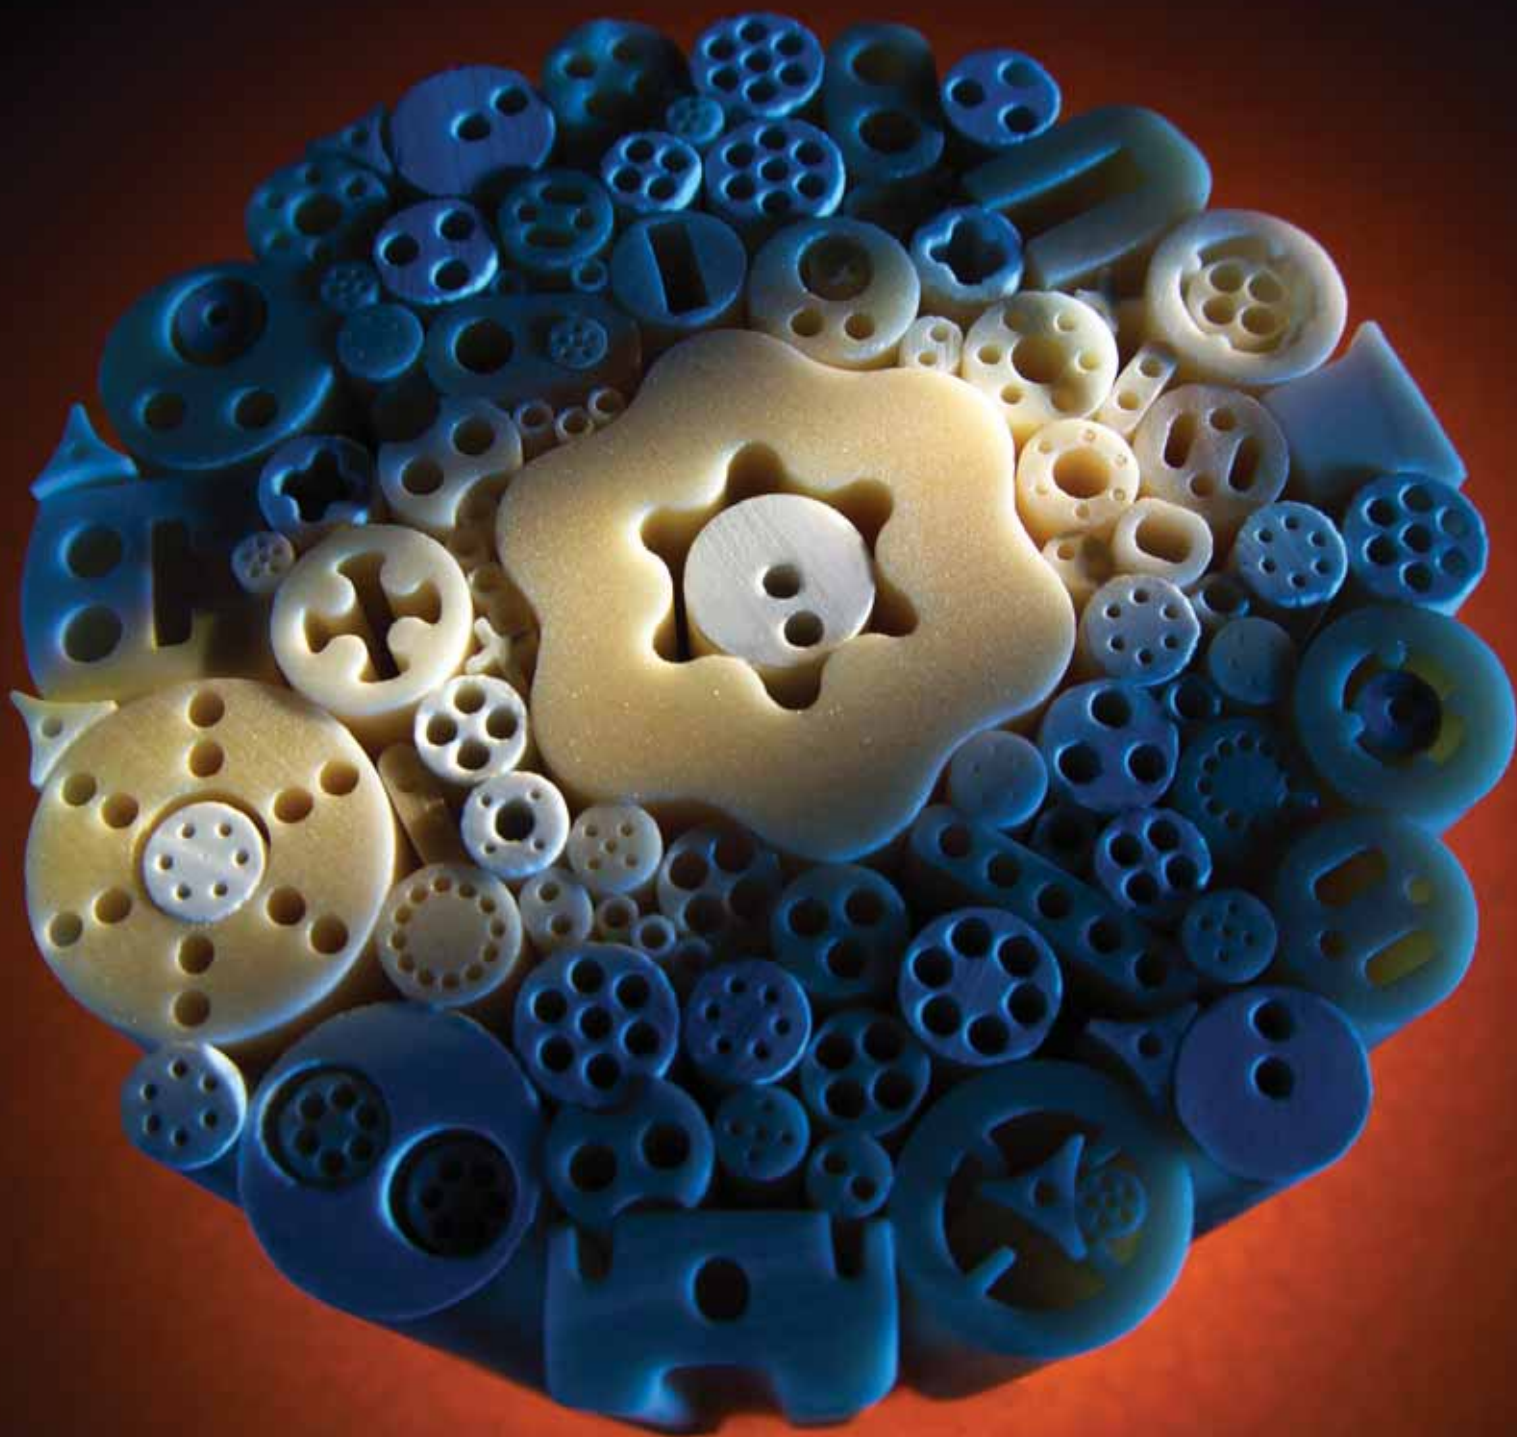


TUBES

MEASUREMENTS/REGULATIONS

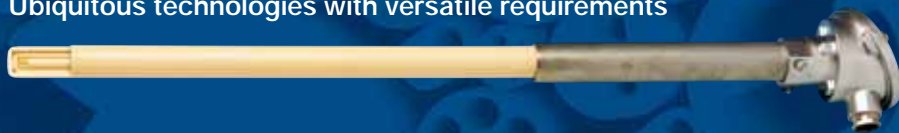
for Thermoelements


W. HALDENWANGER
Technische Keramik GmbH & Co. KG
A member of the Morgan Crucible Company Plc



MEASUREMENTS, CONTROLS, REGULATIONS

Ubiquitous technologies with versatile requirements



Whether in research and development, in modern industrial production or even in the home – there is no area in which measurements, control processes and regulations are not required. Today, there are constantly increasing demands for data accuracy. At the same time, the operating conditions for measuring and regulation instruments are becoming consistently stricter, resulting from, for example, temperature change endurance or aggressive mediums.



Owing to their competent high-tech material, technical ceramics made by W. HALDENWANGER have a tradition of performing strikingly well in a variety of extreme applications. This brochure shows a selection of possible applications within measurement and control technology and delivers important information for engineering and construction of ceramic components.

Aluminium oxide ceramic is commonly used to protect delicate sensors which are in constant contact with, for example, corrosion and other damaging processing substances.



Plugs for control lines in nuclear power plants are subject to high radiation; here, synthetic materials were not, or only partially resistant. However, our Alsint 99.7 components are resistant. These Alsint 99.7 components are also faultless in radioactive contaminated areas. As a result of the extreme

working temperatures, modern measuring methods such as DTA and DTC require ceramic sheath tubes and other ceramic components – specifically ultrapure Alsint 99.7 is used with DTA and DTC. Laser tubes made of Alsint 99.7 are also used to control the motion sequences of the He-Ne Lasers in harsh operating conditions.



Sheath tubes made of various ceramic materials such as Alsint 99.7, Pythagoras, Sillimantin 60 NG, Sillimantin 60, SiC, Halsic-R and Halsic-I, as well as insulation rods made of Alsint 99.7 or Pythagoras, are applied in the field of temperature measurement.

Within the processes of controlled engineering, corrosion and abrasion, in connection with high temperatures, can result in extreme operational demands which metallic regulation carrying capacities can not withstand. In such cases, Alsint 99.7 or Zirconia components ensure reliable operations.

Technical ceramics reveals its strengths when other materials have long failed to fulfil necessary requirements. The diversity of design and utilization are therefore nearly limitless.



CERAMIC SHEATH TUBES

ALSINT 99.7		PYTHAGORAS		SILLIMANTIN 60
Type C 799 according to DIN EN 60672 Al ₂ O ₃ -content 99.7 %		Type C 610 according to DIN EN 60672 Al ₂ O ₃ -content approx. 60 %, Alkali-content 3 %		Type C 530 according to DIN EN 60672 Al ₂ O ₃ -content 73 – 75 %
Outer / Inner Ø in mm	Outer / Inner Ø in mm	Outer / Inner Ø in mm	Outer / Inner Ø in mm	Outer / Inner Ø in mm
0.8 x 0.3	12.0 x 8.0	0.8 x 0.3	14.0 x 10.0	15 x 10
1.3 x 0.7	12.7 x 8.9	1.3 x 0.7	15.0 x 10.0	20 x 15
1.6 x 1.0	14.0 x 10.0	1.6 x 1.0	15.0 x 11.0	22 x 17
1.8 x 1.2	15.0 x 10.0	1.8 x 1.2	16.0 x 12.0	24 x 19
2.0 x 1.0	17.0 x 12.0	2.0 x 1.0	17.0 x 12.0	26 x 18
2.7 x 1.7	17.0 x 13.0	2.7 x 1.7	17.0 x 13.0	28 x 22
3.0 x 2.0	17.5 x 11.1	3.0 x 2.0	17.5 x 11.1	30 x 23
4.0 x 2.0	20.0 x 15.0	4.0 x 2.0	20.0 x 15.0	
5.0 x 3.0	24.0 x 18.0	5.0 x 3.0	24.0 x 19.0	
6.0 x 4.0	25.4 x 19.1	6.0 x 4.0	25.4 x 19.1	
8.0 x 5.0	26.0 x 20.0	8.0 x 5.0	26.0 x 18.0	
9.0 x 6.0	28.0 x 22.0	9.0 x 6.0	26.0 x 20.0	
9.6 x 6.4	30.0 x 23.0	10.0 x 6.0	28.0 x 22.0	
10.0 x 6.0		10.0 x 7.0	30.0 x 23.0	
10.0 x 7.0		12.0 x 8.0		
max. length 3500 mm depending on outer Ø		max. length 3500 mm depending on outer Ø		max. length 3500 mm depending on outer Ø

SILICON CARBIDE		HALSIC-R		HALSIC-I
fine and coarse structure, SiC-content approx. 70 and 90 %, clay-bound		According to DIN EN 12212 recrystallized SiC, SiC-content ≥ 99 %		According to DIN EN 12212, reaction- bound, Si-infiltrated SiC, SiC-concentration approx. 90 %, Si-free content ca. 10 %
Outer / Inner Ø in mm	Outer / Inner Ø in mm	Outer / Inner Ø in mm	Outer / Inner Ø in mm	Outer / Inner Ø in mm
17 x 12	30 x 23	20 x 10	34 x 24	20 x 13
20 x 12	33 x 28	22 x 12	35 x 25	22 x 15
20 x 15	35 x 27	25 x 15	38 x 25	25 x 18
22 x 17	40 x 32	30 x 15	40 x 30	27 x 20
24 x 19	45 x 25	30 x 20	45 x 35	30 x 20
26 x 18	45 x 35	32 x 22	50 x 38	45 x 35
26 x 20	50 x 25			
max. length 2000 mm depending on outer Ø		max. length 2100 mm depending on outer Ø		max. length 2100 mm depending on outer Ø





Dimensions not included in the table can be custom made upon request.

All of the following tubes are available: both ends open, one end closed, both ends open with flange, one end closed with flange. Tolerances are in compliance with DIN 40 680. Customized tolerances upon request.

2-BORE AND 4-BORE INSULATION RODS

Tools available

Insulation rods made of Alsint 99.7 or Pythagoras are used to insulate inserted thermal wires. In accordance with DIN 43725, Pythagoras insulation rods can be heated to temperatures up to 2732°F/1500°C. For higher temperatures, we recommend Alsint 99.7 insulation rods.

ALSINT 99.7 TYPE C 799						PYTHAGORAS TYPE C 610					
2-bore rods			4-bore rods			2-bore rods			4-bore rods		
											
* O Ø/B Ø	O Ø/B Ø	O Ø/B Ø	* O Ø/B Ø	O Ø/B Ø	O Ø/B Ø	* O Ø/B Ø	O Ø/B Ø	O Ø/B Ø	* O Ø/B Ø	O Ø/B Ø	O Ø/B Ø
1.2 0.2	5.2 0.2	7.9 1.8	1.5 0.3	5.5 1.3	10.0 1.8	1.1 0.3	5.1 1.5	8.5 2.5	1.5 0.3	4.9 1.1	8.7 2.2
1.2 0.3	5.2 1.6	8.0 2.0	1.7 0.4	5.6 1.0	10.0 3.1	1.2 0.2	5.1 1.9	8.7 2.3	1.7 0.4	4.9 1.4	8.8 2.5
1.4 0.3	5.2 1.7	8.2 1.8	2.3 0.5	5.6 1.3	10.2 2.7	1.2 0.3	5.2 1.7	9.0 2.0	2.1 0.5	5.1 1.2	9.1 2.5
1.7 0.3	5.2 1.8	8.2 2.5	2.4 0.5	5.6 1.5	10.3 2.3	1.4 0.3	5.2 1.9	9.1 2.4	2.3 0.5	5.2 1.1	9.2 2.1
1.9 0.6	5.4 1.3	8.3 1.6	2.4 0.6	5.7 1.2	10.5 1.1	1.5 0.4	5.4 1.8	9.2 2.8	2.3 0.6	5.2 1.3	9.3 2.8
2.0 0.3	5.5 1.5	8.4 2.9	2.6 0.6	5.8 1.2	10.5 1.5	1.6 0.3	5.4 1.9	9.4 2.9	2.4 0.6	5.3 1.0	9.4 1.8
2.0 0.4	5.5 1.8	8.5 1.3	2.7 0.5	5.8 1.5	10.7 2.5	1.8 0.6	5.5 0.9	9.7 2.7	2.5 0.5	5.3 1.1	9.4 3.0
2.0 0.6	5.5 1.9	8.7 2.5	2.7 0.6	5.9 1.5	11.6 2.5	1.9 0.6	5.5 1.1	9.7 3.7	2.5 0.6	5.3 1.2	9.5 1.5
2.1 0.6	5.5 2.0	8.7 2.6	2.7 0.7	6.0 1.3	11.7 3.5	2.0 0.6	5.5 1.8	9.8 3.7	2.5 0.7	5.4 1.1	9.8 1.1
2.3 0.5	5.7 1.1	8.8 1.5	2.8 0.7	6.0 1.4	11.7 3.7	2.1 0.5	5.5 1.9	9.9 3.9	2.6 0.6	5.5 1.2	9.8 1.4
2.7 0.8	5.7 1.8	8.9 0.5	2.9 0.7	6.1 1.8	11.8 3.5	2.1 0.6	5.6 1.5	10.2 2.7	2.7 0.6	5.5 1.5	10.0 2.4
2.9 0.5	5.8 1.4	8.9 2.5	3.2 0.7	6.2 1.7	11.8 3.8	2.6 0.8	5.6 1.8	10.2 3.8	2.8 0.8	5.6 1.5	10.4 3.0
3.0 0.7	5.8 2.0	9.0 1.6	3.3 0.8	6.3 1.7	11.9 3.9	2.7 0.5	5.7 1.9	10.3 3.2	3.0 0.7	5.7 1.2	10.9 2.5
3.1 1.0	5.9 1.0	9.1 2.5	3.5 0.9	6.4 1.2	12.6 3.6	2.9 0.7	5.9 0.9	10.4 3.0	3.1 0.8	5.8 1.6	11.0 3.4
3.2 1.1	5.9 1.2	9.3 2.4	3.6 0.7	6.4 1.6	12.9 4.1	3.0 1.1	5.9 1.8	10.4 3.8	3.3 0.9	5.8 1.7	11.0 3.5
3.3 1.1	5.9 1.8	9.3 3.0	3.6 1.1	6.5 1.7	13.3 3.1	3.1 1.1	5.9 2.0	10.5 3.0	3.4 0.6	5.9 1.7	11.0 3.6
3.4 1.1	5.9 1.9	9.6 2.1	3.8 0.8	6.6 1.5	13.3 3.5	3.2 1.0	6.0 1.0	10.6 3.5	3.4 1.0	6.0 1.2	11.1 3.7
3.6 0.5	5.9 2.0	9.7 2.5	3.8 1.0	6.6 2.0	14.2 3.6	3.4 0.5	6.0 1.5	10.7 2.5	3.4 1.2	6.0 1.6	11.2 3.8
3.6 0.8	6.0 1.5	9.8 2.9	3.9 0.7	6.7 1.0	14.3 3.5	3.4 0.8	6.0 2.0	10.7 3.7	3.5 0.8	6.1 1.5	11.5 3.3
3.7 1.1	6.0 1.8	10.0 2.3	4.0 1.0	6.7 1.9	15.8 3.8	3.5 1.1	6.3 1.5	10.9 1.5	3.5 1.0	6.1 1.7	11.8 3.5
3.7 1.2	6.1 1.9	10.0 3.1	4.0 1.1	7.0 1.5	16.9 4.6	3.5 1.2	6.3 1.8	11.0 3.0	3.6 0.8	6.2 1.5	12.5 3.0
3.8 1.1	6.2 1.0	10.0 3.8	4.1 0.7	7.8 1.5		3.7 1.1	6.4 0.9	11.5 3.0	3.7 0.7	6.2 2.0	12.5 3.4
3.9 1.2	6.2 1.8	10.2 1.5	4.1 0.8	7.8 2.0		3.8 0.5	6.4 1.4	11.5 3.3	3.7 0.9	6.3 1.0	12.5 3.8
4.0 0.8	6.2 2.0	10.2 2.7	4.2 0.7	7.9 1.5		3.8 0.8	6.4 2.4	11.7 4.0	3.8 0.6	6.7 1.8	13.0 3.5
4.0 1.0	6.3 0.9	10.3 2.8	4.2 0.8	8.0 2.3		3.8 0.9	6.5 1.0	11.9 1.1	3.8 0.9	7.3 1.5	13.2 3.6
4.1 0.5	6.3 1.8	10.9 2.7	4.2 1.2	8.3 1.7		3.9 0.9	6.5 1.6	12.0 3.9	3.8 1.1	7.3 1.9	13.2 4.0
4.1 0.9	6.4 1.0	10.9 3.9	4.3 0.7	8.3 1.8		3.9 1.2	6.5 1.9	12.8 4.5	3.9 0.6	7.4 1.5	13.4 3.4
4.1 1.0	6.4 1.5	11.1 3.1	4.3 0.8	8.3 2.3		4.0 1.3	6.5 2.2	13.0 2.4	3.9 0.8	7.8 1.7	14.2 4.0
4.2 1.2	6.4 2.1	11.1 3.9	4.3 1.2	8.4 1.9		4.2 1.2	6.8 2.2	14.1 4.5	3.9 1.1	7.8 2.3	14.8 3.7
4.3 1.3	6.7 1.5	11.3 3.6	4.5 1.3	8.4 2.2		4.2 1.3	7.0 1.1	14.2 4.5	4.0 0.7	7.9 1.9	15.0 3.6
4.3 1.4	6.7 1.8	11.4 2.5	4.6 1.0	8.5 1.5		4.2 1.6	7.0 2.6	15.3 4.8	4.0 1.1	7.9 2.2	15.8 4.5
4.4 1.3	6.8 0.9	11.6 1.5	4.7 0.7	8.5 2.5		4.3 1.2	7.1 2.4	17.7 4.0	4.0 1.2	8.0 1.8	
4.5 1.2	6.8 1.5	12.2 3.3	4.8 0.8	8.6 1.8		4.4 0.9	7.2 2.4	18.3 4.1	4.1 0.7	8.0 2.3	
4.6 1.0	6.8 2.4	12.2 3.4	4.8 1.0	8.6 1.9		4.4 1.0	7.4 1.8		4.2 1.3	8.0 2.4	
4.6 1.2	6.9 1.0	12.3 3.0	4.8 1.1	8.6 2.0		4.4 1.3	7.5 1.9		4.3 0.9	8.0 2.5	
4.7 1.0	6.9 1.6	12.5 4.1	4.8 1.2	8.6 2.3		4.5 1.0	7.7 1.7		4.4 0.7	8.1 1.5	
4.7 1.1	6.9 2.2	12.6 1.2	4.8 1.5	8.8 1.2		4.5 1.5	7.7 2.4		4.5 0.8	8.1 1.7	
4.7 1.3	7.0 1.6	13.6 4.6	5.0 1.1	8.8 1.5		4.6 1.6	7.8 1.6		4.5 0.9	8.1 1.8	
4.7 1.5	7.0 2.0	13.8 2.5	5.0 1.2	8.8 1.8		4.7 1.4	8.2 1.5		4.5 1.1	8.1 1.9	
4.8 1.0	7.2 2.3	15.0 4.6	5.1 1.0	9.1 2.1		4.7 1.7	8.2 2.4		4.5 1.2	8.1 2.3	
4.8 1.5	7.4 2.6	15.1 4.6	5.2 1.2	9.4 2.5		4.9 1.6	8.2 2.6		4.5 1.5	8.2 1.5	
4.9 1.7	7.5 1.1	15.9 3.3	5.2 1.3	9.6 2.9		4.9 1.7	8.4 0.5		4.7 1.1	8.2 1.8	
5.0 1.4	7.6 2.4	16.3 4.9	5.4 1.2	9.7 2.6		4.9 1.8	8.4 2.5		4.7 1.2	8.3 1.2	
5.0 1.8	7.7 2.5		5.5 1.2	9.9 2.8		5.1 1.2	8.5 1.6		4.8 0.9	8.5 1.5	




* O Ø = Outer diameter in mm




B Ø = Bore diameter in mm



MULTI-BORE INSULATION RODS



Tools available

ALSINT 99.7 TYPE C 799 / PYTHAGORAS TYPE C 610

6-bore rods				8-bore rods				10-bore rods			
											
* O Ø	6 x B Ø	O Ø	6 x B Ø	* O Ø	8 x B Ø	O Ø	8 x B Ø	* O Ø	10 x B Ø	O Ø	10 x B Ø
1.5	0.25	1.5	0.25	4.2	0.75	4.0	0.75	5.3	0.40	5.0	0.40
4.0	0.75	4.0	1.10	4.8	0.80	4.5	0.80	5.5	0.80	5.2	0.80
4.4	1.00	4.5	1.10	6.0	0.55	5.0	0.60	5.7	0.65	5.4	0.65
5.0	1.10	5.1	1.20	6.4	1.00	6.0	1.00	6.0	0.75	5.6	0.75
6.0	1.20	6.0	1.10	7.5	0.80	7.0	0.80	7.0	1.10	6.5	1.10
8.0	1.20	7.5	1.20	12.7	2.10	12.0	2.00	8.0	0.70	7.5	0.70

5-bore rods with centre bore				6-bore rods with centre bore				7-bore rods with centre bore			
											
* O Ø	5 x B Ø	O Ø	5 x B Ø	* O Ø	6 x B Ø	O Ø	6 x B Ø	* O Ø	7 x B Ø	O Ø	7 x B Ø
2.7	0.35	2.6	0.35	2.1	0.4	2.0	0.4	2.0	0.25	1.9	0.25
4.5	0.5	4.3	0.5	4.9	0.55	4.6	0.55	3.2	0.3	3.0	0.3
9.4	1.0	8.7	1.0	5.4	1.1	5.0	1.1	17.0	4.0	16.0	3.7

5-bore rods with centre bore and 4 smaller bores						7-bore rods with centre bore and 6 smaller bores					
											
* O Ø	CB Ø	4 x B Ø	O Ø	CB Ø	4 x B Ø	* O Ø	CB Ø	6 x B Ø	O Ø	CB Ø	6 x B Ø
3.0	0.9	0.30	2.8	0.9	0.50	3.7	1.8	0.45	3.5	1.7	0.45
4.0	1.5	0.75	4.5	1.2	0.75	4.0	1.8	0.45	4.0	1.7	0.75
5.0	2.4	0.75	7.7	2.9	1.20	5.0	1.8	0.75	5.0	1.8	0.70
8.5	4.0	0.80	8.0	3.7	0.80	11.0	4.3	2.10	10.4	4.0	2.00
9.0	3.2	1.15	9.2	4.0	1.10	13.3	4.4	2.40	12.5	4.1	2.30

13-bore rods with centre bore and 12 smaller bores						Oval 2-bore rods									
															
* O Ø	CB Ø	12 x B Ø	O Ø	CB Ø	12 x B Ø	W	/	H	x	B Ø	W	/	H	x	D Ø
8.6	4.4	0.3	7.7	4.1	0.3	3.0	/	2.0	x	0.7	2.3	/	1.4	x	0.7
9.6	2.1	1.2	9.0	1.9	1.2	4.5	/	3.0	x	1.5	3.0	/	2.0	x	1.0
9.6	2.1	1.1	9.0	2.0	1.1	7.5	/	5.0	x	2.2	4.0	/	2.7	x	1.0
						11.5	/	7.2	x	3.9	4.6	/	3.3	x	1.5
						12.0	/	8.0	x	4.0	11.5	/	6.3	x	4.2


* O Ø = Outer diameter in mm

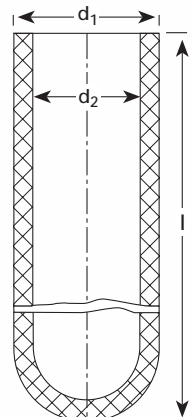
B Ø = Bore diameter in mm

CB Ø = Centre bore diameter in mm

DIN MEASUREMENTS

Measurements for ceramic sheath tubes and insulation components for thermoelements according to DIN 43724 and DIN 43725

 <p>Materials for insulation rods C 610 or C 799 DIN EN 60672</p>	4-bore insulation rods according to DIN 43725			Wire Ø	1-bore insulation rods according to DIN 43725			Wire Ø
	Outer Ø (d ₂) in mm	Bore Ø (d ₃) in mm	Length in mm	Ø in mm	Outer Ø (d ₁) in mm	Inner Ø in mm	Length in mm	Ø in mm
	5.5	1.2	205 275 380 560 770	≤ 0.8	2.7 ± 0.2	1.7	5, 10, 25, 50	1.0 and 1.38
	8.5	1.5	1060 1460 2060	≤ 0.8	4.0 ± 0.3 6.0 ± 0.3	2.0 4.0	5, 10, 25, 50	1.38 3.0

	TABLE 1: ceramic sheath tubes DIN 43724					
	DIN EN 60672	Outer Ø (d ₁) in mm	Inner Ø (d ₂) in mm	Length (L) in mm	Thermal shock resistance	Permeability
	C 610	10	7	200, 270, 375, 530, 740, 1030	medium to good	gastight
		15	11	530, 740, 1030, 1430, 2030		
		24	19	530, 740, 1030, 1430		
	C 530	26	18	530, 740, 1030, 1430	very good	porous
	C 799	10	6	200, 270, 375, 530	medium	gastight
		15	10	530, 740, 1030		
		24	18	530, 740, 1030, 1430		

DESIGN

Unglazed. Admissible tolerance of the wall thickness is in compliance with DIN 40680 Part 1, degree of accuracy: Coarse. Admissible deflection is in compliance with DIN 40680 Part 2, degree of accuracy: Fine, with the following specifications: A straight rod, diameter 0.8 x (d₁-2s), must be able to be inserted to the bottom of the sheath tube. The rounded bottom of the sheath tube uniformly becomes the cylindrical section of the sheath tube.

REQUIREMENTS

Thermal shock resistance:

No visible damage after test implementation.

Dimensional stability: Original straightness after test implementation.

Gastightness: No air is released during testing: only valid for the sheath tubes labelled gastight in Table 1.

TESTS

Thermal shock resistance:

The sheath tube is inserted with the closed end into a 40 mm internal diameter tube furnace at

a constant rate (Table 2). The furnace is heated to the maximum permissible continuous temperature of the sheath tube. The sheath tube must not come in contact with the tube furnace, therefore a vertical setup of the tube furnace is recommended. After a minimum of 20 minutes holding time, the sheath tube is removed at the same rate and is hung freely in order to cool in calm air.

TABLE 2	
Diameter d1 in mm	Insertion rate cm/min
10	100
15	50
24 and 26	1

Dimensional stability:

The sheath tube is horizontally clamped into the tube furnace used for thermal shock resistance testing and is then heated to the maximum permissible continuous temperature. This procedure lasts for 30 minutes.

Gastightness:

The sheath tube is exposed to an inner overpressure of 2 bar, and then submersed in water for one minute.

Note: The tests should be conducted in the abovementioned order. The thermal shock resistance tests and dimensional stability tests can be conducted simultaneously when the tube furnace is setup horizontally.

GUIDELINES

for the selection of sheath tube materials according to DIN 43724, Paragraph 7:

- Alkalis- and hydrofluoric acid-free gases up to 2732 °F / 1500 °C: Type C 610
- Contact with alkali vapours up to 2732 °F / 1500 °C: Type C 799
- Gases of all kinds, if inner tubes are gas-tight, up to 2912 °F / 1600 °C: Type C 530
- Melting glass up to 2732 °F / 1500 °C: Type C 799

(not general specifications; reference values only)

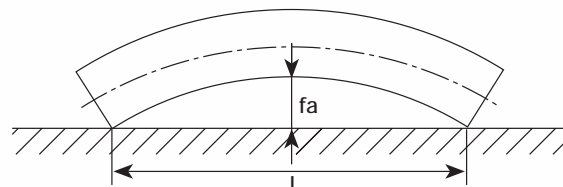
TOLERANCES ACCORDING TO DIN 40680

Diameter and deflection tolerances without grinding according to DIN 40680

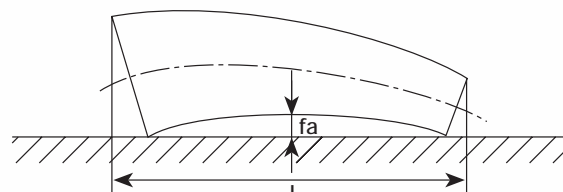
Nominal Ø or length in mm		Accuracy (admissible tolerances in mm)		Nominal length in mm		Accuracy (admissible deflection fa in mm)	
		coarse	medium			coarse	medium
up to	4	± 0.4	± 0.15	up to	30	1.7	0.15
above 4 up to	6	± 0.6	± 0.20	above 30 up to	40	1.8	0.20
above 6 up to	8	± 0.7	± 0.25	above 40 up to	50	1.9	0.25
above 8 up to	10	± 0.8	± 0.30	above 50 up to	60	2.0	0.30
above 10 up to	13	± 1.0	± 0.35	above 60 up to	70	2.1	0.35
above 13 up to	16	± 1.2	± 0.40	above 70 up to	80	2.1	0.40
above 16 up to	20	± 1.2	± 0.45	above 80 up to	90	2.2	0.45
above 20 up to	25	± 1.5	± 0.50	above 90 up to	100	2.3	0.50
above 25 up to	30	± 1.5	± 0.55	above 100 up to	110	2.4	0.55
above 30 up to	35	± 2.0	± 0.60	above 110 up to	125	2.5	0.65
above 35 up to	40	± 2.0	± 0.65	above 125 up to	140	2.6	0.70
above 40 up to	45	± 2.0	± 0.70	above 140 up to	155	2.7	0.80
above 45 up to	50	± 2.5	± 0.80	above 155 up to	170	2.9	0.85
above 50 up to	55	± 2.5	± 0.90	above 170 up to	185	3.0	0.90
above 55 up to	60	± 2.5	± 1.00	above 185 up to	200	3.1	1.00
above 60 up to	70	± 3.0	± 1.20	above 200 up to	250	3.5	1.25
above 70 up to	80	± 3.5	± 1.40	above 250 up to	300	3.9	1.50
above 80 up to	90	± 4.0	± 1.60	above 300 up to	350	4.3	1.75
above 90 up to	100	± 4.5	± 1.80	above 350 up to	400	4.7	2.00
above 100 up to	110	± 5.0	± 2.00	above 400 up to	450	5.1	2.25
above 110 up to	125	± 5.5	± 2.20	above 450 up to	500	5.5	2.50
above 125 up to	140	± 6.0	± 2.50	above 500 up to	600	6.3	3.00
above 140 up to	155	± 6.5	± 2.80	above 600 up to	700	7.1	3.50
above 155 up to	170	± 7.0	± 3.00	above 700 up to	800	7.9	4.00
above 170 up to	185	± 7.5	± 3.40	above 800 up to	900	8.7	4.50
above 185 up to	200	± 8.0	± 3.80	above 900 up to	1000	9.5	5.00
above 200 up to	250	± 9.0	± 4.20	above 1000	1.5 + 0.8 % · l		0.5 % · l
above 250 up to	300	± 10.0	± 4.60	Please contact us for stricter tolerances.			
above 300 up to	350	± 11.0	± 5.00				
above 350 up to	400	± 12.0	± 5.50	Manufacturing process		Degree of accuracy coarse medium	
above 400 up to	450	± 13.0	± 6.10	Casted, turned, extruded for parts with an envelope size of 30 mm and higher		Common application	
above 450 up to	500	± 14.0	± 6.80				
above 500 up to	600	± 15.0	± 7.60	Extruded for parts with an envelope size up to 30 mm, non-metered pressed, metered semi-moist pressed, metered dry pressed, white machined			Common application
above 600 up to	700	± 16.0	± 8.30				
above 700 up to	800	± 17.5	± 9.00				
above 800 up to	900	± 19.0	± 9.50				
above 900 up to	1000	± 20.0	± 10.00				
above 1000		± 0.02 · d	± 0.01 · d				
Accuracy		coarse		medium			
DIN EN 60672 Type		C 610	C 799	C 610	C 799		
Manufacturing processes							
Casted		•	•				
Turned		•					
Extruded envelope size 30 mm and higher		•	•				
Extruded envelope size up to 30 mm				•	•		
Non-metered pressed				•			
Metered semi-moist pressed			•				
Metered dry pressed					•		
White machined				•	•		
The values for accuracy: Course are not applicable to the first manufacturing. Special agreements are required.							
• Customary manufacturing process							

Deflection of a cylindrical formed part

Deflection of a non-cylindrical formed part



Deflection of a cylindrical formed part



Deflection of a non-cylindrical formed part

Variety
TUBES

Excellent Surface Finish
FUSED SILICA ROLLERS

Tradition
LABORATORY PORCELAIN



Long Service Life
ROLLERS

High Performance
HALSIC

Flexibility
SPECIALITIES



W. HALDENWANGER
Technische Keramik GmbH & Co. KG

Teplitzer Str. 27 · D-84478 Waldkraiburg
Tel. +49-(0)8638 60 04 60
Fax +49-(0)8638 60 04 317
info@haldenwanger.de
www.haldenwanger.de



Haldenwanger forms part of the Morgan Advanced Ceramics group, which is a global business unit of the Morgan Crucible Company Plc.

Morgan
MorganAdvancedCeramics
www.morganadvancedceramics.com

beat the heat
beat the heat

www.haldenwanger.de